



March 2026 GETS Update: Three years of 24/7 Operation and 450 Million Gallons of Effective PFAS Treatment

March 30, 2026

See the Latest Results:


The Groundwater Extraction and Treatment System (GETS) has been operating continuously for more than three years and has successfully treated over 450 million gallons of water. Data collected over this time confirm that the system consistently meets its design objectives.

All system activities, performance results, and recommended improvements are reported to the Wisconsin Department of Natural Resources (WDNR). Tyco continues to work closely with the WDNR under an approved long-term monitoring plan to track system performance, while also conducting ongoing testing and reporting in accordance with the WPDES discharge permit. To date, the system has successfully treated all water, as shown in the chart below.

The GETS dashboard will continue to be updated regularly with the latest data.

GETS System

PFOA and PFOS Data
● Influent ◆ Effluent

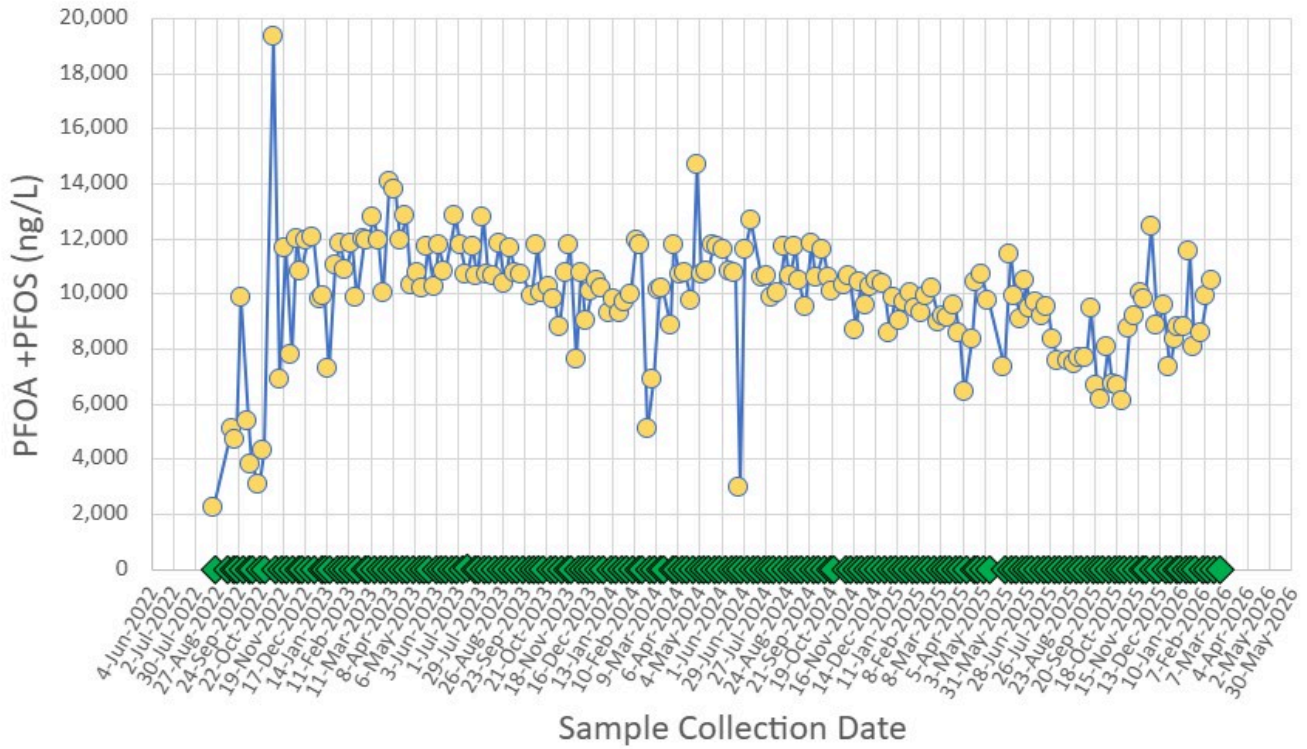

[View All Latest Updates](#)

If you have any questions, please call our dedicated phone line: (715) 582-7100

Stay Informed: Subscribe for Updates

